

Ductwork & AHU Cleaning

CASE STUDY

FOOD MANUFACTURING INDUSTRY


CHALLENGE



One of the UK's leading food manufacturing facilities had been experiencing air hygiene complications across their facility.

HVDS attended the site to perform an investigation of the air handling system. Upon completion, it was discovered that the floors of the air handling units were in a poor condition, they were subject to ingress and there was some deterioration to the surface of the floors as well as staining to the interior walls and doors of the AHU's. Further investigation also highlighted a large amount of debris in the ductwork throughout the facility.

These issues, not only have a negative impact on operating efficiency, but if left without essential maintenance could have also posed significant health & safety issues.

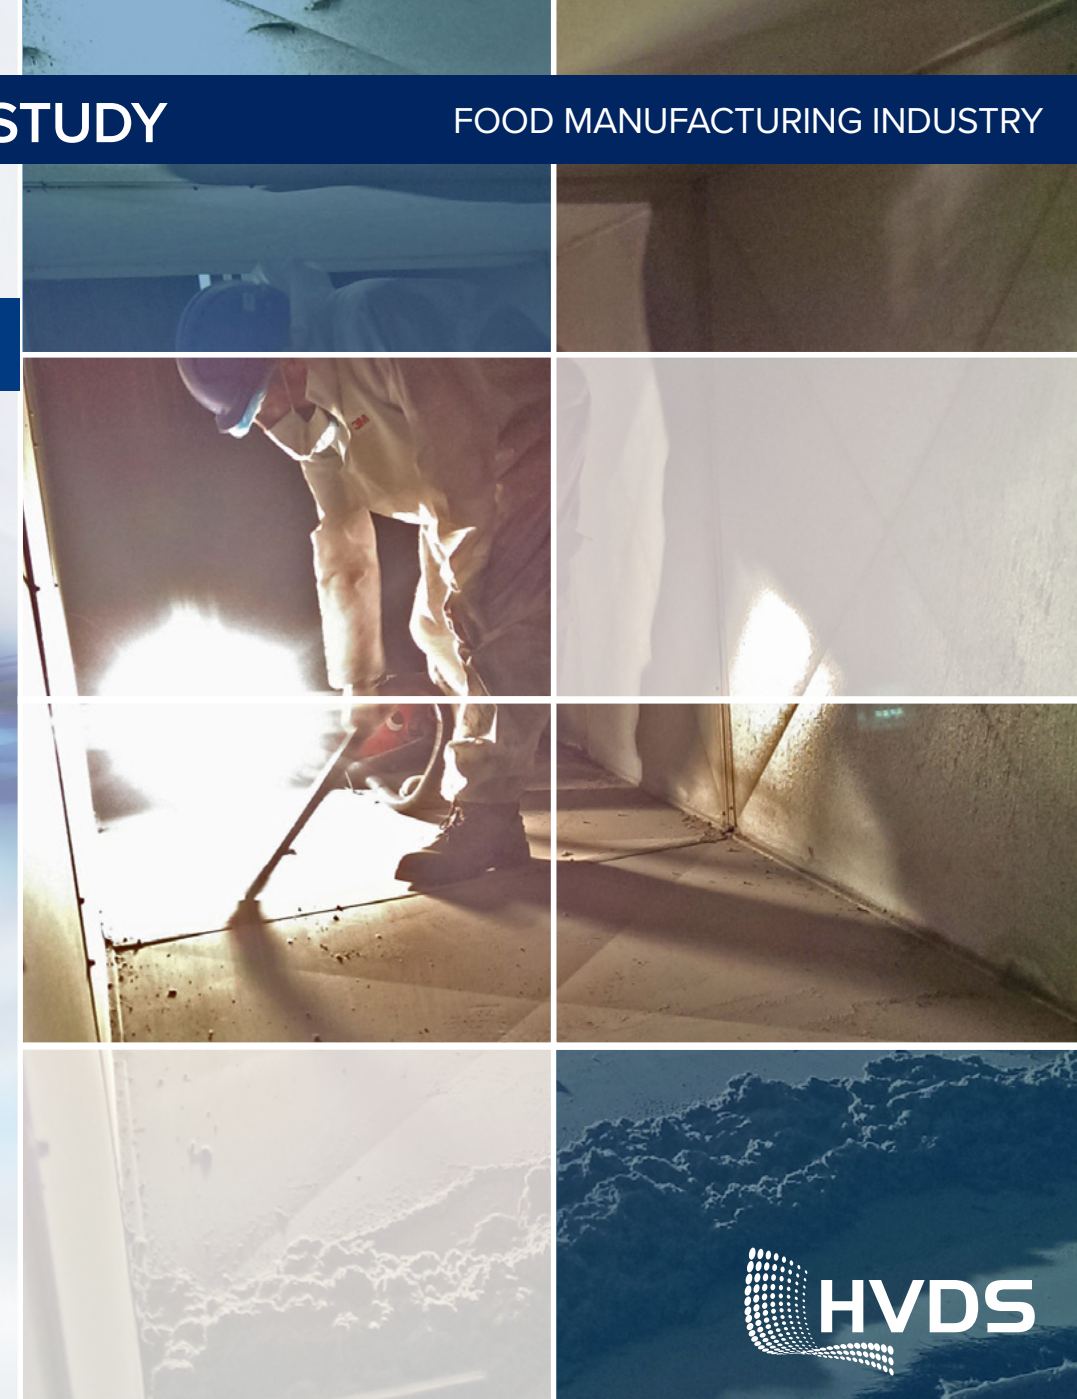

CASE STUDY

DUCTWORK & AHU CLEANING


Your Trusted Partner in Clean Air

SOLUTION

HVDS performed the relevant cleaning and maintenance to the affected areas as part of the customers **4D FUSION™** Air Filtration and Ventilation Management Contract

The handling system across the facility underwent thorough and professional cleaning, which included removal of all debris from the AHU's and ductwork as well as deep cleaning and sanitation of the AHU access doors.

Thanks to the experience of the highly trained HVDS engineers, the manufacturing facility remained fully operational during both the investigation and maintenance. Once the air handling cleaning and maintenance was performed the customer was able to benefit from increased operational facility and audit compliance.

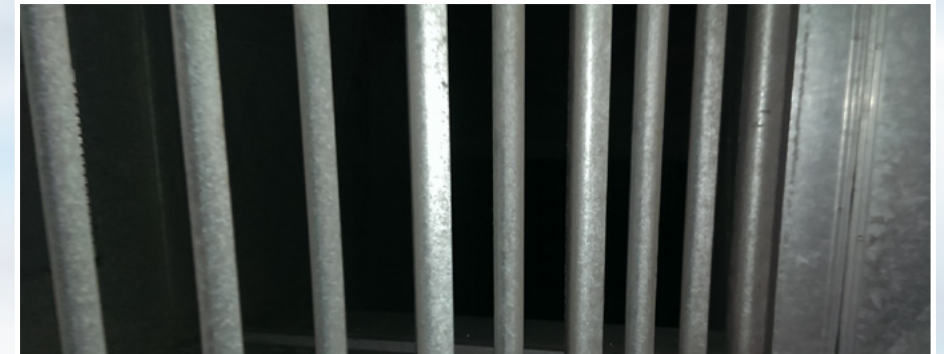

www.hvds.co.uk
info@hvds.co.uk
+44 (0) 1785 256976

